


NOTE: CONCRETE SHALL BE CLASS "C".

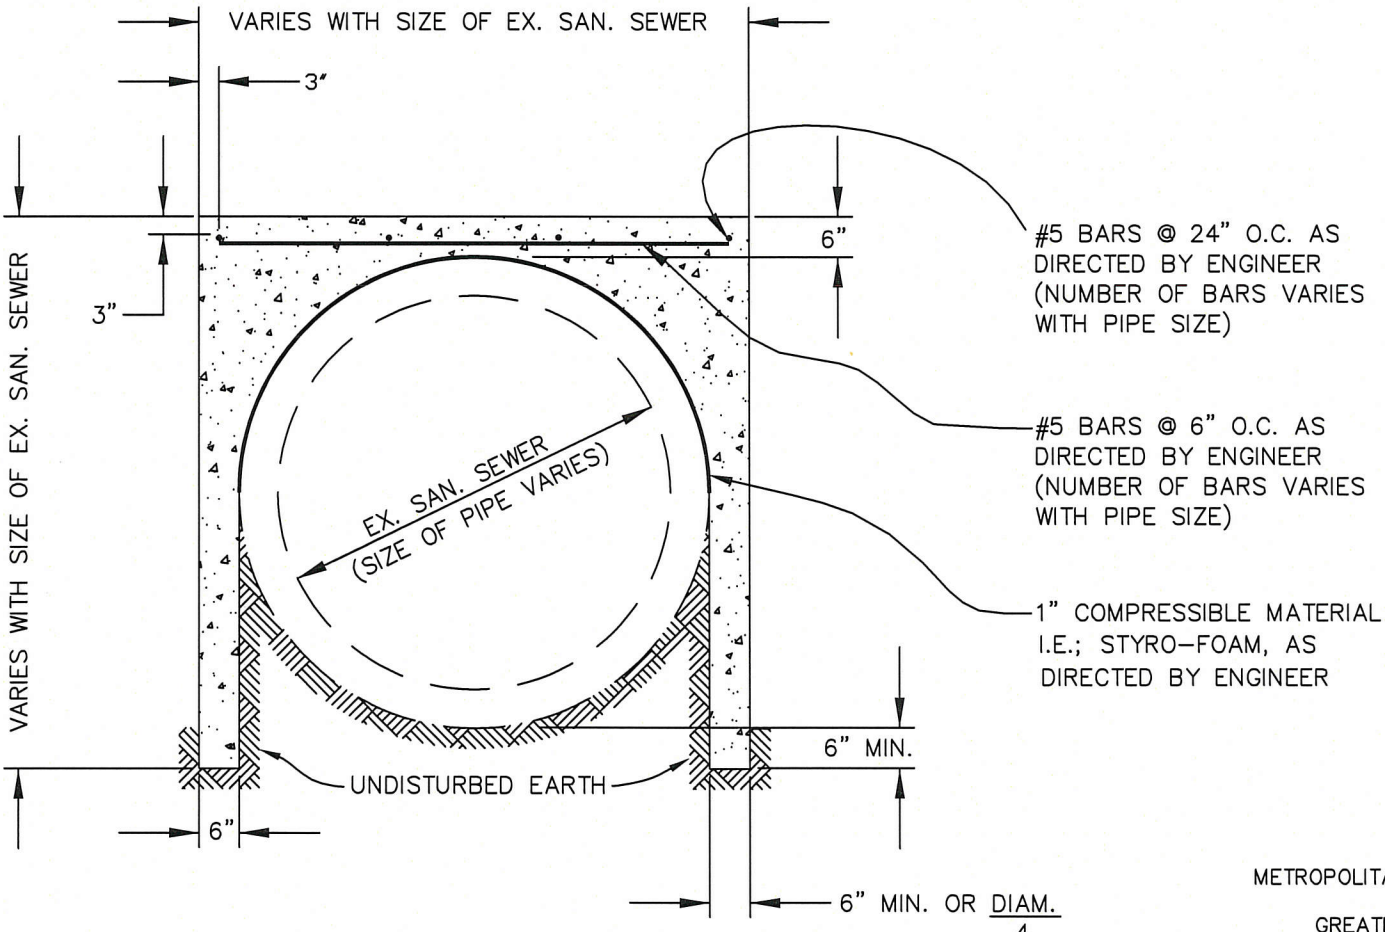

#5 BARS @ 24" O.C. AS DIRECTED BY ENGINEER (NUMBER OF BARS VARIES WITH PIPE SIZE)

#5 BARS @ 6" O.C. AS DIRECTED BY ENGINEER (NUMBER OF BARS VARIES WITH PIPE SIZE)

1" COMPRESSIBLE MATERIAL I.E.; STYRO-FOAM, AS DIRECTED BY ENGINEER

THE METROPOLITAN SEWER DISTRICT OF GREATER CINCINNATI  
TYPICAL ENCASEMENT FOR EXISTING SANITARY PIPE

NO SCALE DATE: AUG., 2006  
APPROVED: [Signature] SEWERS CHIEF ENGINEER

C.J.K./T.R.S.

ACC. NO. 49057