


INSTRUCTIONS

1. Installation of Building Sewers shall be done in accordance with M.S.D. Rules and Regulations.
2. Building Sewers are to be laid perpendicular to the main sewer direction of flow, spring line to spring line, and within produced property lines.
3. No deviation from instructions on the sewer permit will be permitted without permission from M.S.D.
4. Install bends as necessary on each side of the two-way cleanout so that the casting is flush with the ground.

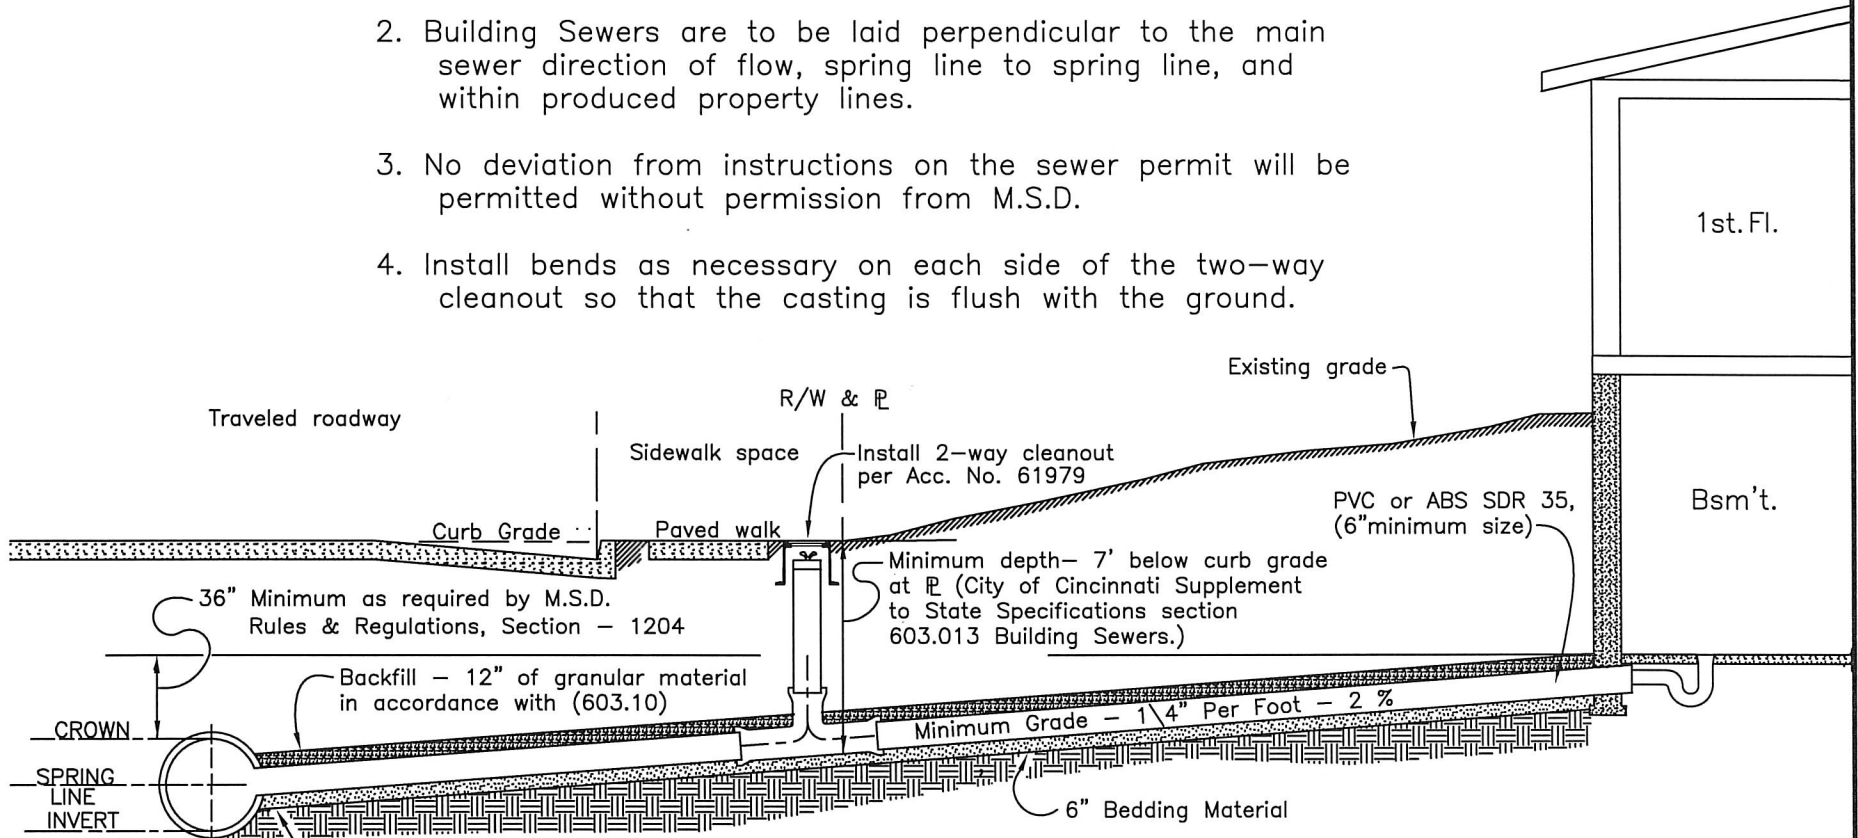


SEE ACC NO. 49033 for Connection and/or stack detail.

SEE ACC. NO. 49053 for Connection to a Brick Sewer.

All fittings used for 6" PVC or ABS pipe connections shall be Wye only fittings for new main line conduits.

Approved tapping saddles may be used for existing main line connections.

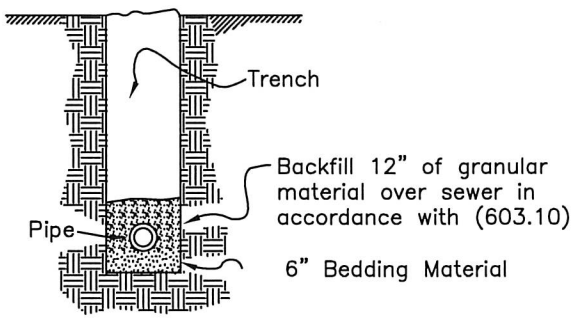

THE
METROPOLITAN SEWER DISTRICT
OF
GREATER CINCINNATI

**TYPICAL INSTALLATION
OF BUILDING SEWER LATERAL**

NO SCALE DATE: MAY 2016

APPROVED: *Robert A. Smith*
SEWERS CHIEF ENGINEER